


J:\nd\_Service\Project Files\Greenwich\_High\_School\GIS\Projects\Exceedances\_of\_Screening\_Criteria\_For\_GW\_SW\_02\_29\_12.mxd

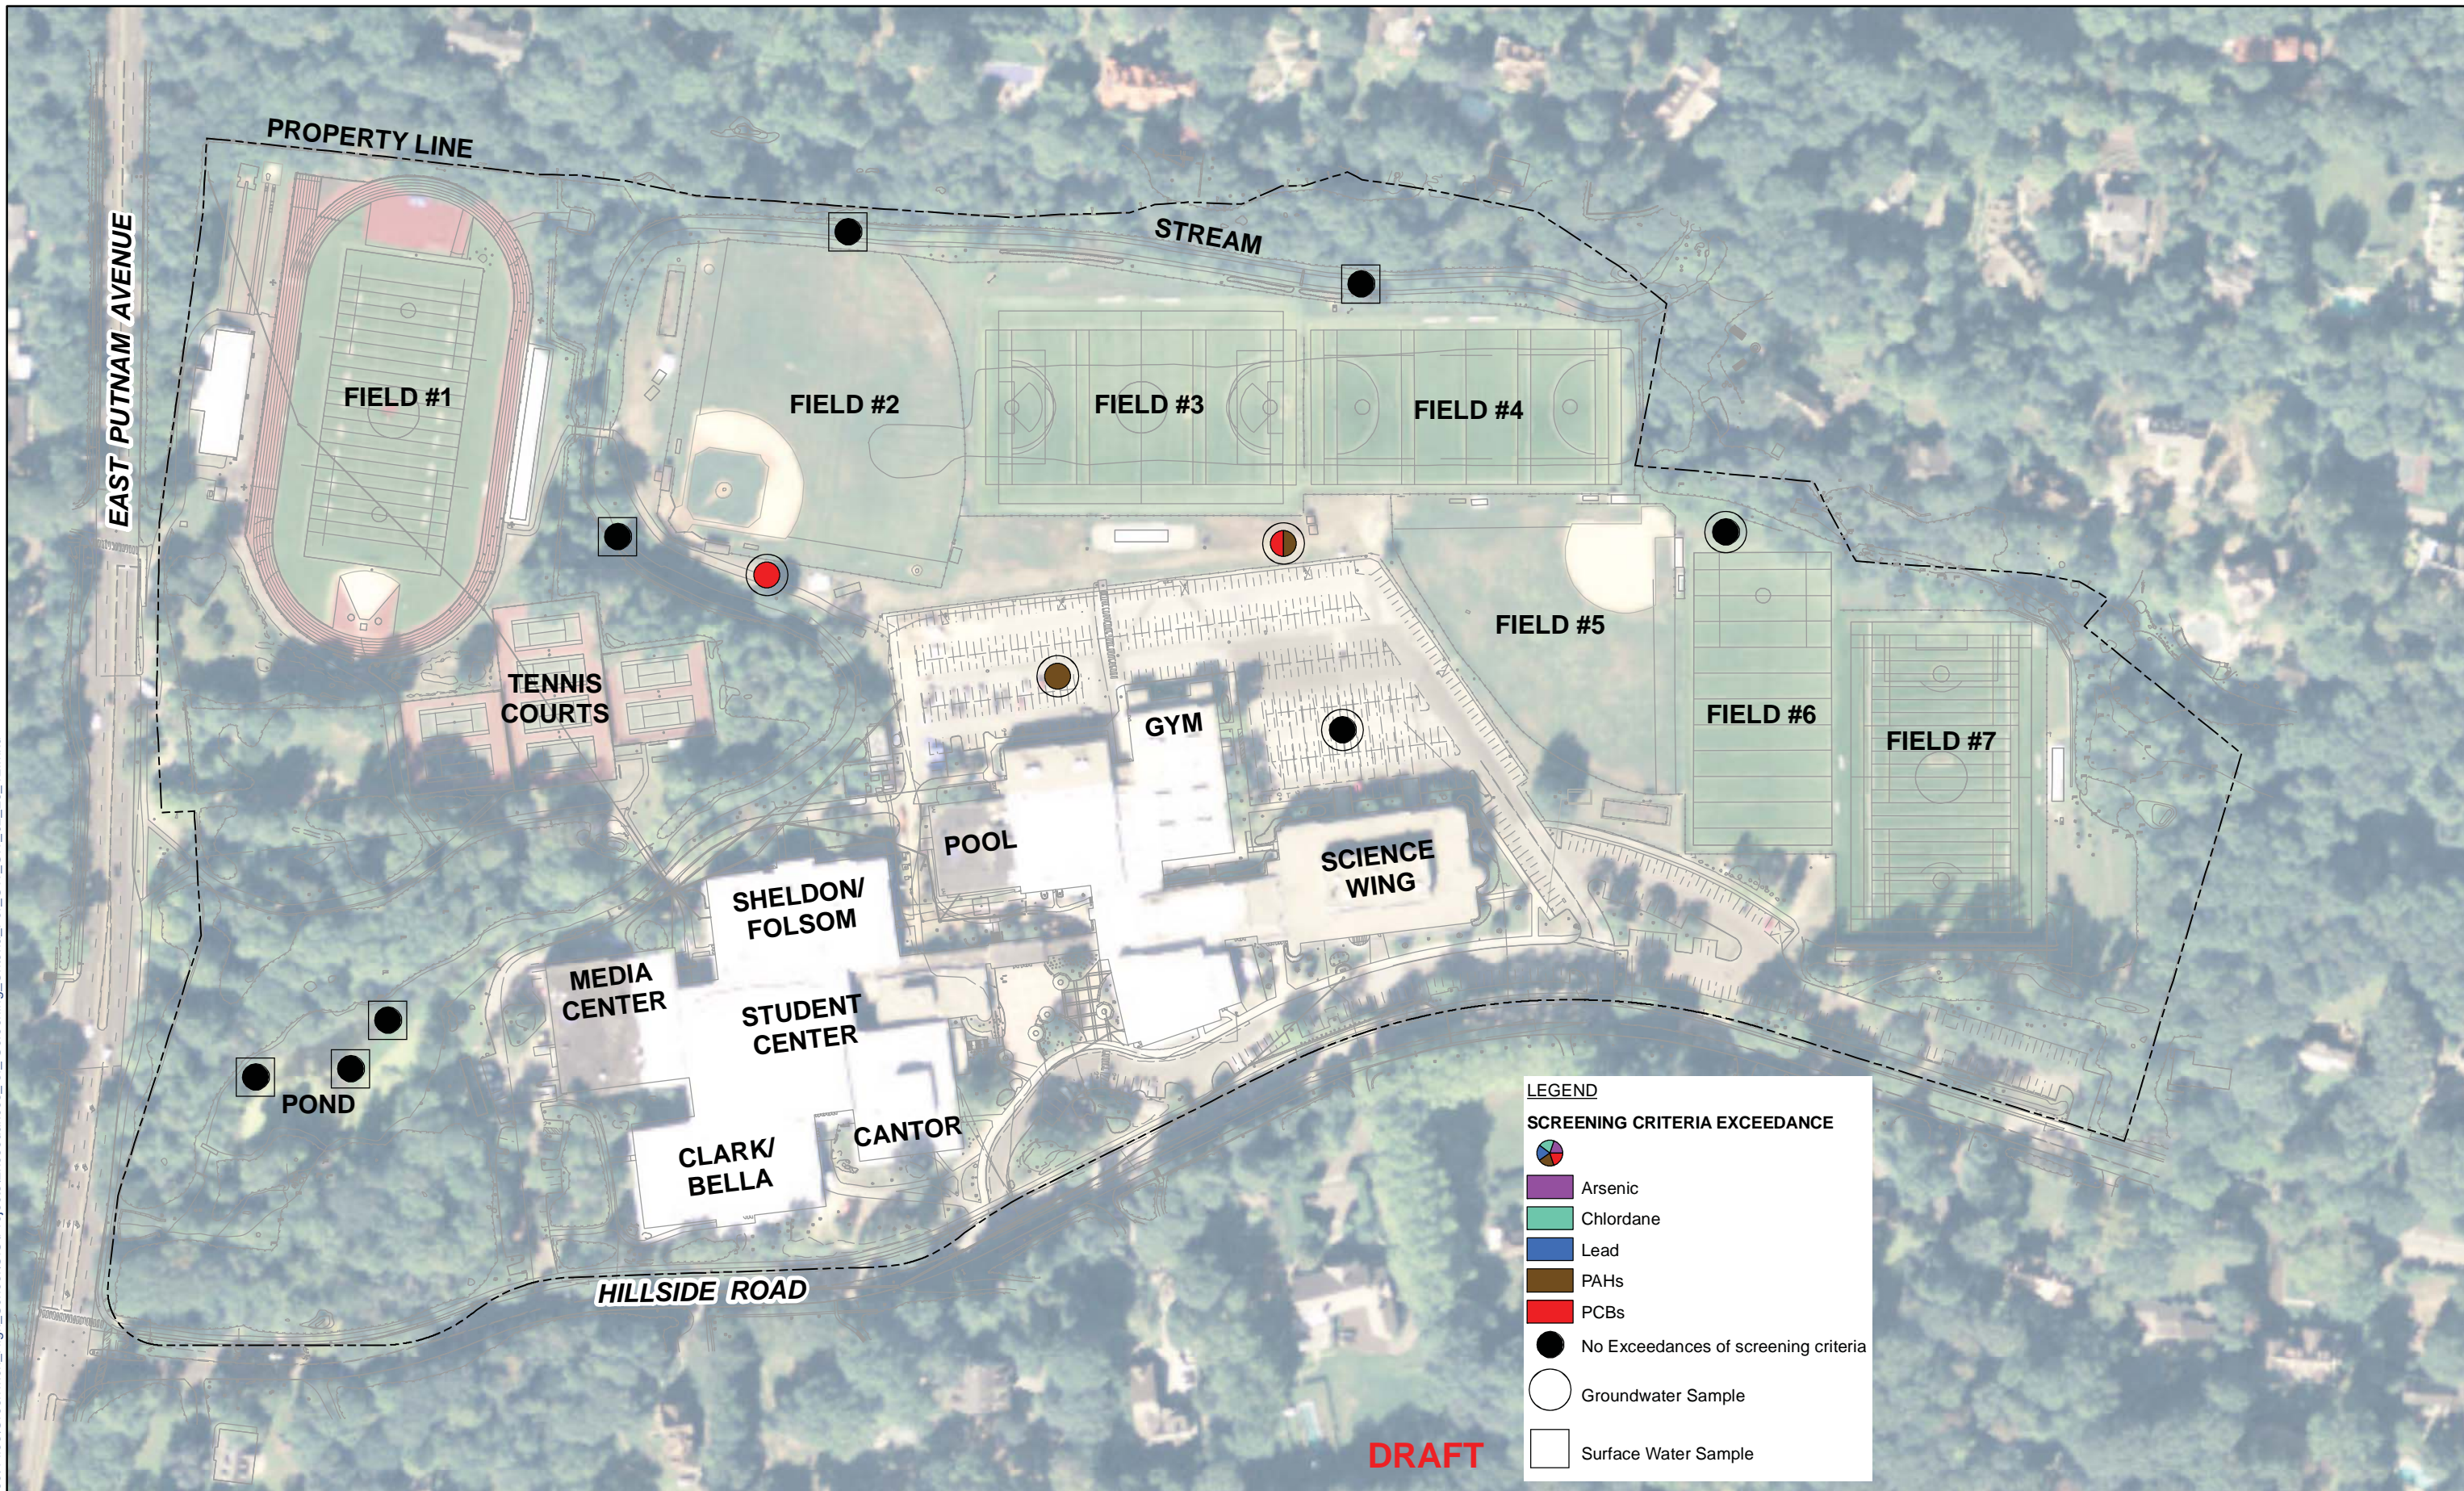

**DRAFT**



**LEGEND**

**SCREENING CRITERIA EXCEEDANCE**

- Arsenic
- Chlordane
- Lead
- PAHs
- PCBs
- No Exceedances of screening criteria
- Groundwater Sample
- Surface Water Sample



SOURCE:  
2010 AERIAL ORTHOPHOTO FROM STATE OF CONNECTICUT  
DEPARTMENT OF ENERGY & ENVIRONMENTAL PROTECTION.



GREENWICH HIGH SCHOOL  
10 HILLSIDE ROAD  
GREENWICH, CT  
60225155.0500

EXCEEDANCES OF SCREENING  
CRITERIA FOR GROUNDWATER  
AND SURFACE WATER

DATE: 02/29/12

DRWN: J.E.B.

FIGURE